

Pollution Control Unit Specification

Construction

PCU Series shall be factory assembled pollution control unit capable of significantly reducing smoke, grease and odor from the exhaust air stream.

Housing: The PCU housing is to be constructed of 430 SS of polish 2B or better. All metal in contact with the air-stream is to be constructed of 430 SS. 1500°F Ceramic based gasket must be in place for all internal seams exposed to airflow. High temperature weatherproofing gasket must be used on all exterior seams. A 1 ½" NPT drain is to be installed in the base of each module of the unit to aid in cleaning. An airflow switch must be installed in the final compartment of the PCU to enable an indicating light.

Base: The base shall be constructed of galvanized steel for improved rigidity. Base shall be structurally reinforced to accommodate the filter assembly.

Pre-Filter Section: The pre filter section shall include 4 inch deep steel washable permanent filters. Filter frames and media shall be constructed of steel. Filters shall be arranged in a v-bank configuration to increase filter area and reduce static pressure. All filters shall be removable without the use of tools through side access doors with lift and turn latches. Filters are to be cleanable with a water hose and soapy water. The filters shall have a minimum average arrestance of 75% in accordance with ASHRAE 52.1-1992.

High Efficiency Filter Section: The phase two filters shall consist of 4 inch deep rigid cell extended surface filters. Filter cell sides shall be constructed of high strength, high impact polystyrene plastic for durability. Beverage board filter sides shall not be permitted. Filters shall be arranged in a v-bank configuration to increase filter area and reduce static pressure. All filters shall be removable without the use of tools through side access doors with lift and turn latches. Filters are to be rated MERV 14 minimum in accordance with ASHRAE standard 52.2 and have a minimum average arrestance of 98% in accordance with ASHRAE 52.1-1992. High Efficiency module must be installed downstream of pre-filter module.


Final Filter Section (Optional): Final filter section shall consist of 4 inch deep Mini-pleat HEPA rated filters. Filter cell sides shall be constructed of steel or aluminum for durability. Beverage board filter sides shall not be permitted. Filters shall be arranged in a v-bank configuration to increase filter area and reduce static pressure. All filters shall be removable without the use of tools through side access doors with lift and turn latches. Filters are to be rated MERV 18 minimum in accordance with ASHRAE standard 52.2 and have a minimum average arrestance of 99% in accordance with ASHRAE 52.1-1992. HEPA module must be installed downstream of High Efficiency module.

Odor Control Media Section (Optional): The unit shall be provided with a 50% potassium permanganate 50% carbon blend (100% permanganate) (100% carbon) (Caustic impregnated) media. The odor removal cartridges shall be encased in steel frames. The odor removal media shall be arranged in a v-bank configuration to increase filter area and reduce static pressure. All media shall be removable without the use of tools through side access doors with lift and turn latches. Odor control module must be installed downstream of High Efficiency module or HEPA module.

Certifications

The PCU Series has been certified by ITS. This certification mark indicates that the product has been tested to and has met the minimum requirements of a widely recognized (consensus) U.S. and Canadian products safety standard, that the manufacturing site has been audited, and that the applicant has agreed to a program of periodic factory follow-up inspections to verify continued performance. Models PCU are ETL Listed under file number 3130718COL-001 and comply with UL710 Standards and ULC710 Standards.

Typical Installation


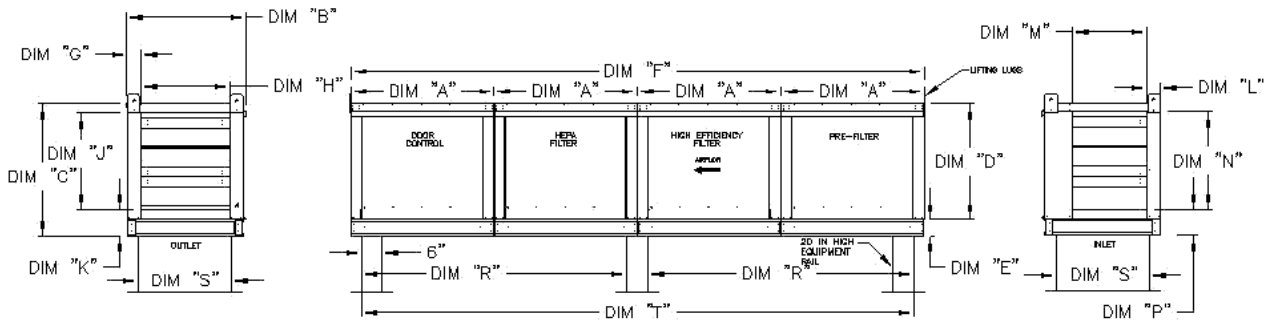


MODEL	UNIT INFORMATION		UNIT DIMENSIONS								DISCHARGE OPENING				INTAKE OPENING				RAIL DIMENSIONS			
	WEIGHT	FILTER SIZE & QTY*	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T			
SIZE 1	515 LBS	20" x 25" x 4" (3)	32-1/8	28-3/4	29-3/4	28	3-3/4	128-7/8	3-1/8	19-7/8	21-7/8	5-3/4	3-1/8	16-3/4	21-7/8	5-3/4	59-7/16	21	124-7/8			
SIZE 2	855 LBS	16" x 20" x 4" (6)	32-1/8	38-3/4	38-3/4	33	3-3/4	128-7/8	5-1/8	27-7/8	28-7/8	5-3/4	5-1/8	24-3/4	28-7/8	5-3/4	59-7/16	31	124-7/8			
SIZE 3	1030 LBS	20" x 25" x 4" (6)	36-1/8	48-3/4	45-3/8	38-1/8	5-1/4	152-7/8	4-5/8	32-3/8	33-7/8	7-1/2	4-5/8	28-1/4	33-7/8	7-1/2	71-7/16	36	149-7/8			
SIZE 4	1435 LBS	18" x 20" x 4" (12)	35-1/4	47-7/8	51-3/8	46-1/8	5-1/4	141-3/8	4-5/8	35-3/8	41-7/8	7-1/2	4-5/8	36-1/4	41-7/8	7-1/2	65-11/16	42	137-3/8			
SIZE 5	1450 LBS	20" x 25" x 4" (12)	35-1/4	58-5/8	58-3/8	53-1/8	5-1/4	141-3/8	4-5/8	50-1/8	48-7/8	7-1/2	4-5/8	47	48-7/8	7-1/2	85-11/16	52-3/4	137-3/8			


ALL DIMENSIONS ARE NOMINAL AND GIVEN IN INCHES.
 C/US UL710 LISTED FOR GREASE DUCT INSTALLATION
 WHEN USED IN KITCHEN GREASE DUCT, UNIT MUST BE INSTALLED DOWNSTREAM OF A LISTED HOOD ASSEMBLY
 *FILTER QUANTITY SHOWN IS PER MODULE
 DRAIN SUPPLIED IN EACH MODULE FOR WASHDOWN

Typical Installation of Air Pressure Switch

Switches are preset from plant to 0.15" w.c. above the internal static pressure of the PCU with clean filters. The Air pressure switch is located in the downstream filter module. Route wiring from hood control panel to PCU using 1/2" conduit through quick seal located near lower right area of filter module containing switch. Use existing conduit in module to route wires from exterior of module to switch. Install wiring according to label above switch. Be sure all conduit fittings are tight. Once filters become clogged, switch closes illuminating light in kitchen. User should then clean or replace filters as required.

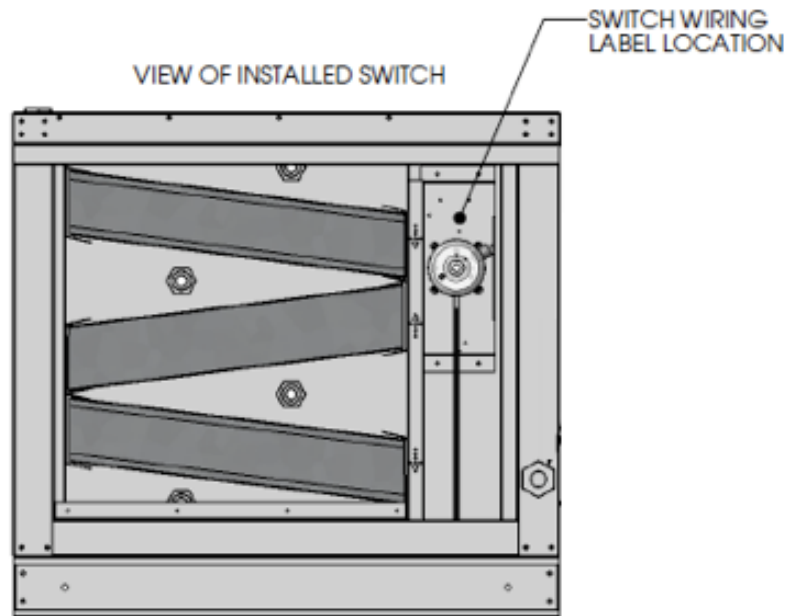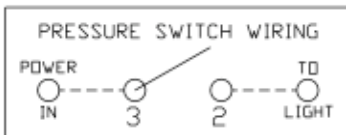

Pressure Drop Curve PCU Size 1 Shown

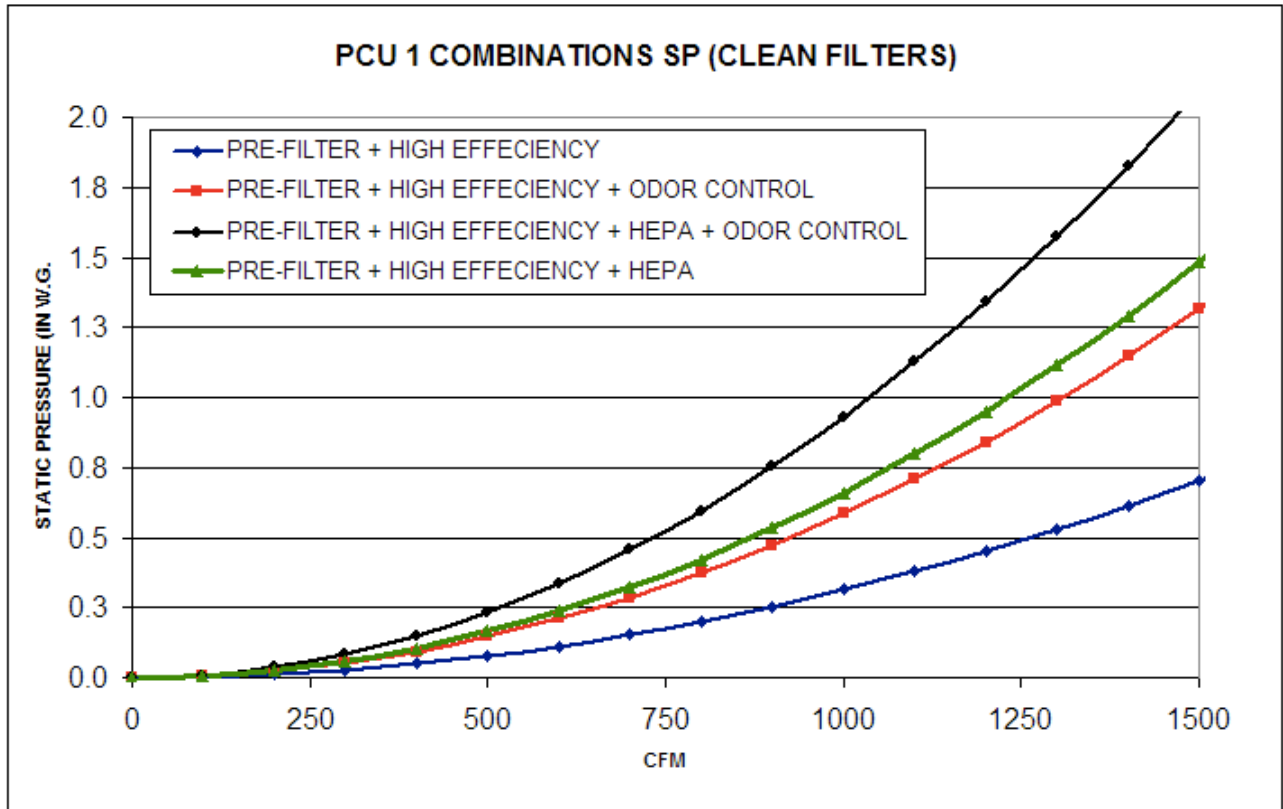

Centrifugal PCU Exhaust Fan Specification

Model KB fan shall be a backward incline, roof mounted or indoor, belt drive, up-blast centrifugal exhaust ventilator. Steel centrifugal roof exhausters are engineered to discharge grease laden vapors, fumes and other contaminants.

Construction

Housing: The fan housing shall be constructed of stainless steel. The internal structural support and external mounting material shall be 14 GA G90 galvanized steel minimum.

Base: The base shall be constructed of galvanized steel for improved rigidity. Bolt patterns shall be provided in the base to allow connection to a pollution control unit.

Wheel: The fan wheel shall be centrifugal backward inclined and non-overloading. Wheels shall be balanced in two planes and done in accordance with AMCA standard 204-96, Balance Quality and Vibration Levels for Fans. The wheel blades shall be aerodynamically designed to minimize turbulence, increase efficiency and reduce noise. The wheel blades shall be welded to the wheel inlet cone. In the event that balancing weights are required they shall be riveted to the blades or wheel. The wheel inlet shall overlap the fan inlet for maximum performance and efficiency. The wheel shall be firmly attached to the motor shaft with two setscrews.

Motor & Motor Compartment: Motors shall be heavy-duty ball bearing type, mounted on an adjustable base and furnished at the specified voltage, phase and enclosure. Motor mounting plate shall be constructed of heavy gauge steel and isolated from the fan structure with vibration isolators. The motor shall be Totally Enclosed and Fan Cooled and have high temp class F insulation. Motors shall be washdown duty. The motor compartment shall be of a two-piece construction quick release clips to provide quick and easy access to the motor compartment.

Shaft & Bearings: Shafts shall be precision ground and polished. Heavy duty, pre-lubricated bearings shall be selected for a minimum (L50) life in excess of 200,000 hours of operation at maximum cataloged operating speed. They shall be designed for and individually tested specifically for use in air handling applications.


Belts & Drives: Belts shall be oil and heat resistant, non-static type. Drives shall be cast type, precision machined and keyed and secured attached to the fan and motor shafts. Drives shall be sized for a minimum of 150% of the installed motor horsepower. Fan operating speed shall be factory set using adjustable pitch motor pulleys.

Safety Disconnect Switch: A safety disconnect switch shall be standard on all units. Switches shall be installed in a NEMA3R enclosure and mounted to exterior of the fan for easy access.

Certifications

Captive-Aire Systems, Inc. certifies that KB models shown herein are ETL Listed under file numbers 3158877SAT-001 and comply with UL762 Standards and CSA Standard C22.2, No. 113.

Typical Installation

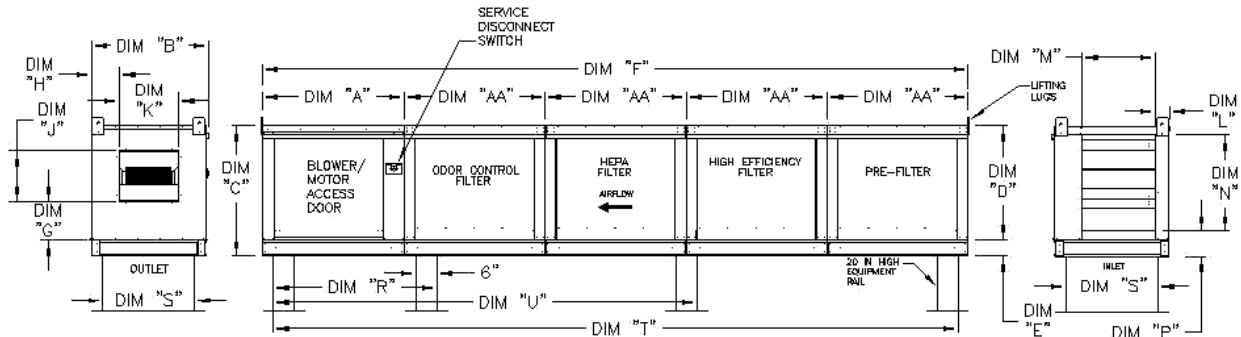

UNIT INFORMATION	UNIT DIMENSIONS													DISCHARGE OPENING				INTAKE OPENING				RAL DIMENSIONS			
MODEL/WEIGHT	FILTER SIZE & QTY*	A	AA	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T	U					
SIZE 11720 LBS	20"x25"x4" (3)	52-1/8	52-1/8	67-5/8	29-3/4	28	5-3/4	181-1/8	8-5/8	8-1/2	13-1/8	13-1/8	5-1/8	118-3/4	121-7/8	3-4/8	3-4/8	1-4	21	187-1/8	87-11/16				
SIZE 21215 LBS	18"x20"x4" (6)	40-1/8	40-1/8	57-3/8	36-3/4	33	5-3/4	189-1/8	10-3/16	8-15/16	18-5/16	18-5/16	5-1/8	124-3/4	128-7/8	3-4/8	3-4/8	1-4	31	185-1/8	105-11/16				
SIZE 31485 LBS	20"x25"x4" (6)	65-1/2	65-1/2	81-5/8	43-7/8	39-1/8	5-7/8	199-1/8	12-15/16	11-1/2	22-7/8	22-7/8	5-7/8	136-1/4	143-7/8	1-7/8	1-7/8	1-4	35	194-1/8	122-11/16				
SIZE 42170 LBS	18"x20"x4" (15)	64-3/16	64-3/16	81-3/8	46-1/8	41-1/2	5-7/8	205-11/16	13-1/2	11-1/2	25-5/8	25-5/8	5-8	141-3/8	147-3/8	1-7/8	1-7/8	1-4	42	201-11/16	136				
SIZE 52855 LBS	20"x25"x4" (12)	74-3/16	74-3/16	91-5/8	53-7/8	47-1/8	5-7/8	215-11/16	16-7/8	12-15/16	32-1/16	32-1/16	5-8	147-3/8	154-3/8	1-7/8	1-7/8	1-4	47	208-5/16	148				

ALL DIMENSIONS ARE NOMINAL AND GIVEN IN INCHES.
 CFM5 UL710 LISTED FOR GREASE DUCT INSTALLATION.
 WHEN USED IN KITCHEN GREASE DUCT, UNIT MUST BE INSTALLED DOWNSTREAM OF A LISTED HOOD ASSEMBLY.
 *FILTER QUANTITY SHOWN IS PER MODULE.
 DRAIN SUPPLIED IN EACH MODULE FOR WASHDOWN.

Pressure Drop Curve Model KB10 Shown

